


CUSTOMER TO SUPPLY PROPERLY PROTECTED
INCOMING POWER AS PER LOCAL CODES.
(USE 75°C COPPER WIRE ONLY)

[INCOMING POWER]
240V 3Ø 60-HZ

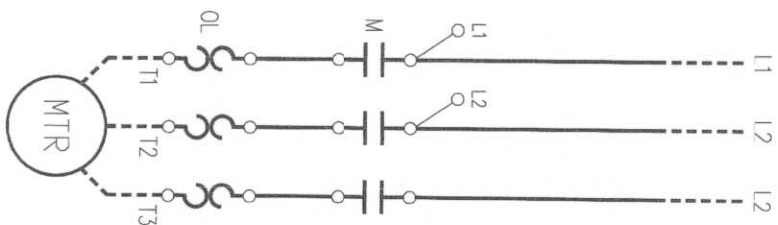


240V


*SEE SPECIFIC ORDER FOR PRIMARY VOLTAGE

BXXXXT13JK TYPE XFEMER			
PRIMARY CONNECTIONS			
VOLTAGE	LINE	JUMPER	
220/230/240	H1 H4	H1 H3/H2 H4	
440/480/480	H1 H4	H3 H2	
SECONDARY CONNECTIONS			
110/115/120V	X1 X2	NA	

*SEE TABLE

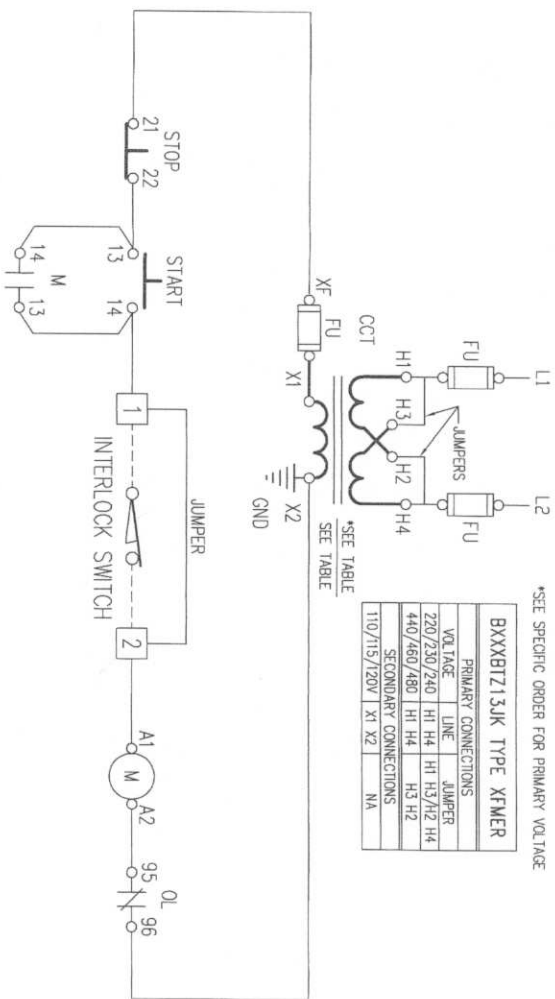

TERM. BLOCK DETAIL



NOTES:

- 1) TB JUMPER TO BE REMOVED IF INTERLOCK SWITCH IS USED.
- 2) X2 TERMINAL GROUNDED AS STANDARD, REMOVE IF NOT REQUIRED.

NOTICE

THIS DRAWING IS THE CONFIDENTIAL PROPERTY OF SPRECHER SCHUH INC. and, as such, is subject to recall at any time. The drawing may not be reproduced, used or disclosed for any purpose except as authorized by SPC/THP, SCHUH INC.

DRAWN BY: MB
CHECKED BY: MB
APPROVED BY: MH
DATE

CUSTOM CONTROL PANEL
FVNR W/ START/STOP
PART NUMBER - 3215G-P
AUBURN ARMATURE - MORSE MFG

sprecher+
schuh HOUSTON,
DWG. NO. SHEET 3 OF 3
CCP WS-615-1999