


CUSTOMER TO SUPPLY PROPERLY PROTECTED
INCOMING POWER AS PER LOCAL CODES.
(USE 75°C COPPER WIRE ONLY)


[INCOMING POWER]
480V 3Ø 60HZ

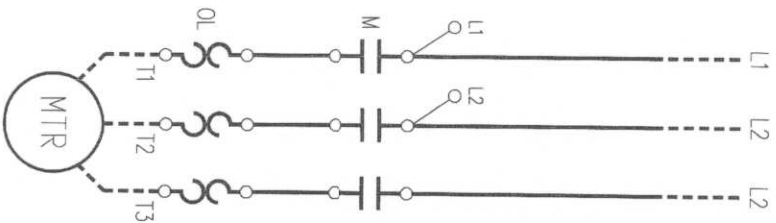


NON COMBINATION
2.6FLA

*SEE SPECIFIC ORDER FOR PRIMARY VOLTAGE

BXXXXBT13JK TYPE XFMR			
PRIMARY CONNECTIONS			
VOLTAGE	LINE	JUMPER	
220/230/240	H1 H4	H1 H3/H2 H4	
440/460/480	H1 H4	H3 H2	
SECONDARY CONNECTIONS			
110/115/120V	X1 X2	NA	

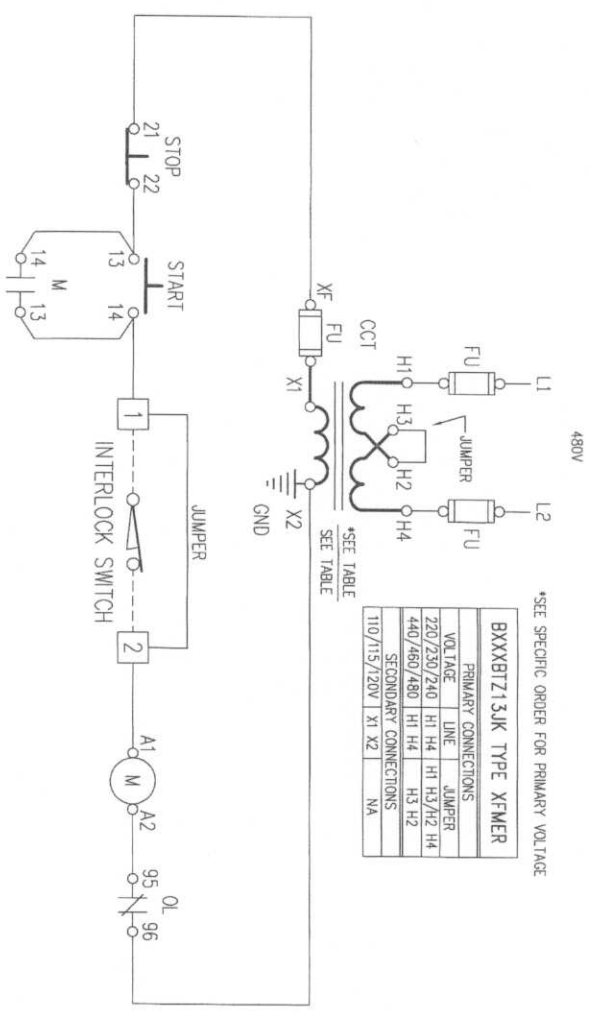

TERM. BLOCK DETAIL



NOTES:

- 1) TB JUMPER TO BE REMOVED IF INTERLOCK SWITCH IS USED.
- 2) X2 TERMINAL GROUNDED AS STANDARD, REMOVE IF NOT REQUIRED.

NOTICE

THIS DRAWING IS THE CONFIDENTIAL
PROPERTY OF SPECHER-SCHUH INC.
and, as such, is subject to recall at
any time. The drawing may not be
reproduced, used or disclosed for
any purpose except as authorized by
Sprecher-Schuh Inc.

DRAWN BY:
MB

CHECKED BY:
MB

APPROVED BY:
MH

DATE

CUSTOM CONTROL PANEL
FNVR W/ START/STOP
PART NUMBER - 3216C-P
AUBURN ARMATURE - MORSE MFG

sprecher+
schuh HOUSTON,
TX

DWG. NO. COP WS-615-1999

SHEET 3 OF 3